

Steico 40mm ENG

internal wall
created on 14.12.2022

Thermal protection

$$U = 0,13 \text{ W}/(\text{m}^2\text{K})$$

Heated on both sides: No requirement*



Moisture proofing

Condensate: 245 g/m²

Dries 18 days

Drying reserve: 1029 g/m²a





Heat protection

Temperature amplitude damping: 12

phase shift: 9,2 h

Thermal capacity inside: 24 kJ/m²K

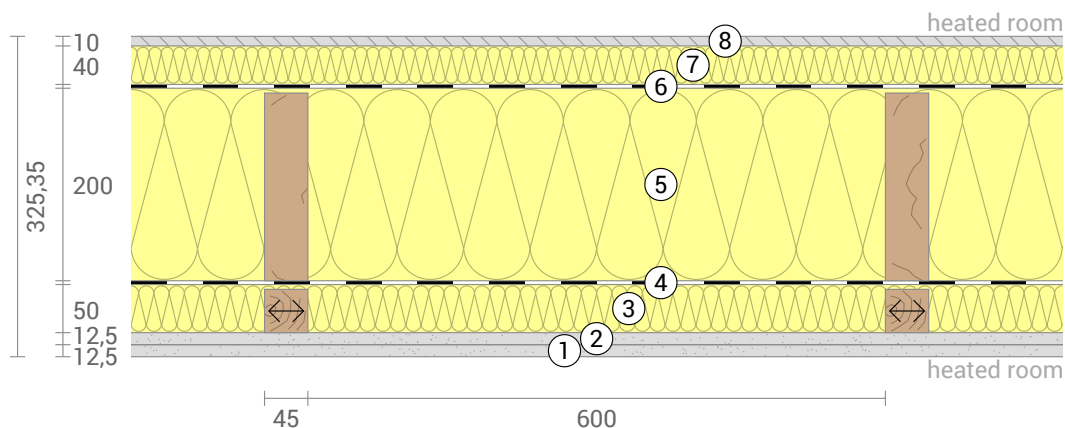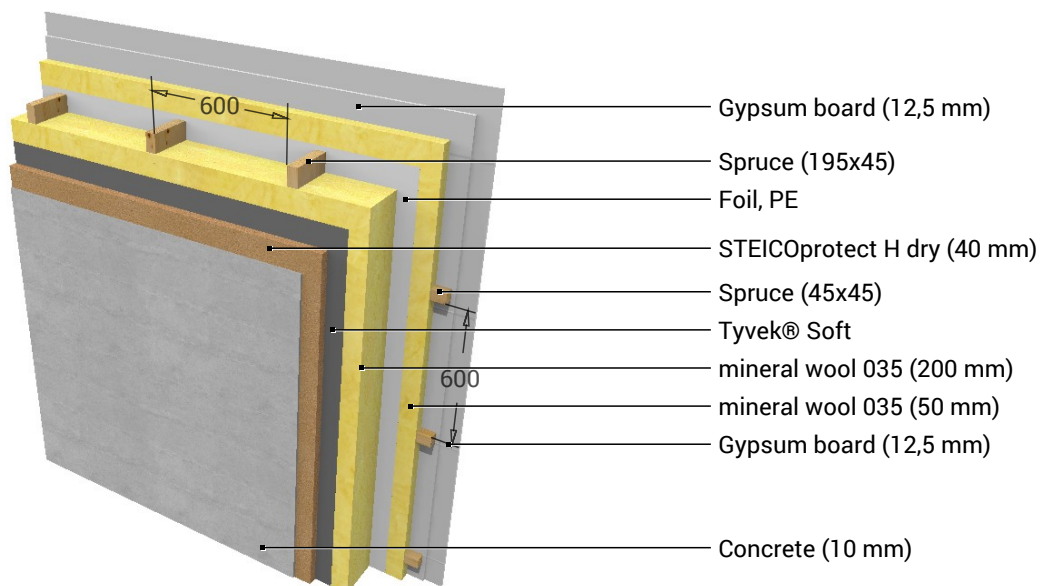

- | | | |
|----------------------------|-----------------------------|-------------------------------|
| ① Gypsum board (12,5 mm) | ④ Foil, PE | ⑦ STEICOprotect H dry (40 mm) |
| ② Gypsum board (12,5 mm) | ⑤ mineral wool 035 (200 mm) | ⑧ Concrete (10 mm) |
| ③ mineral wool 035 (50 mm) | ⑥ Tyvek® Soft | |

<-> Layers marked by arrows are perpendicular to the main axis.

Inside air : 20,0°C / 50%
Inside air 2: -20,0°C / 30%
Surface temperature.: 18,5°C / -19,8°C

sd-value: 22,4 m

Thickness: 32,5 cm
Weight: 61 kg/m²
Heat capacity: 68 kJ/m²K

☐ GEG 2020 Bestand

☐ BEG Einzelmaßn.

☐ GEG 2020 Neubau

☒ DIN 4108

U-Value calculation according to DIN EN ISO 6946

#	Material	Dicke [cm]	λ [W/mK]	R [m ² K/W]
	Thermal contact resistance inside (Rsi)			0,130
1	Gypsum board	1,25	0,250	0,050
2	Gypsum board	1,25	0,250	0,050
3	mineral wool 035	5,00	0,035	1,429
	Spruce (Width: 4,5 cm)	4,50	0,130	0,346
4	Foil, PE	0,02	0,400	0,001
5	mineral wool 035	20,00	0,035	5,714
	Spruce (Width: 4,5 cm)	19,50	0,130	1,500
6	Tyvek® Soft	0,02	0,230	0,001
7	STEICOprotect H dry	4,00	0,043	0,930
8	Concrete	1,00	2,000	0,005
	Thermal contact resistance outside (Rse)			0,130

Thermal contact resistances have been taken from DIN 6946 Table 7.

Rsi: heat flow direction horizontally

Rse: heat flow direction horizontally, outside: Heated room

Upper limit of thermal resistance $R_{\text{tot;upper}} = 7,845 \text{ m}^2\text{K/W}$.

Lower limit of thermal resistance $R_{\text{tot;lower}} = 7,347 \text{ m}^2\text{K/W}$.


Check applicability: $R_{\text{tot;upper}} / R_{\text{tot;lower}} = 1,068$ (maximum allowed: 1,5)

The procedure may be used.

Thermal resistance $R_{\text{tot}} = (R_{\text{tot;upper}} + R_{\text{tot;lower}})/2 = 7,596 \text{ m}^2\text{K/W}$

Estimated maximum relative uncertainty according to section 6.7.2.5: 3,3%

Heat transfer coefficient $U = 1/R_{\text{tot}} = 0,13 \text{ W}/(\text{m}^2\text{K})$

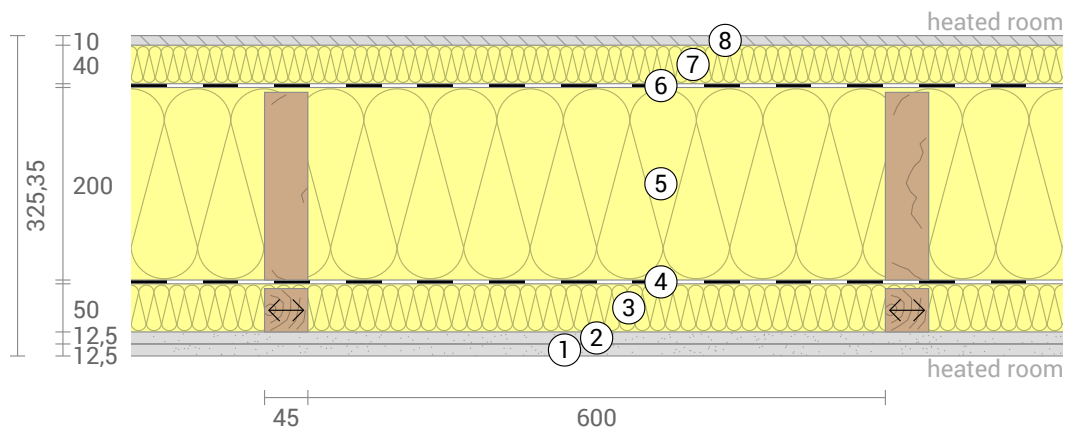


LCA

Heat loss: 10 kWh/m² per heating season




Amount of heat that escapes through one square meter of this component during the heating period. Please note: Due to internal and solar gains, the heating demand is lower than the heat loss.

Primary energy (non renewable): 77 kWh/m²




Non-renewable primary energy (= energy from fossil fuels and nuclear energy) that was used to produce the new building materials ("cradle to gate").

Green house gas potential: -4,3 kg CO₂ Äqv./m²




For the production of the building materials used, more greenhouse gases were withdrawn from the atmosphere than emitted.


Composition of non-renewable primary energy of production:

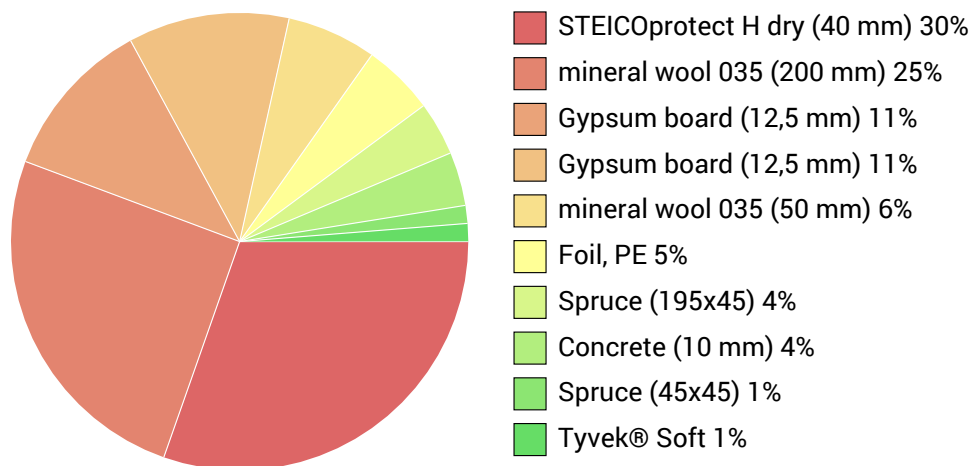

Composition of the greenhouse potential of production:

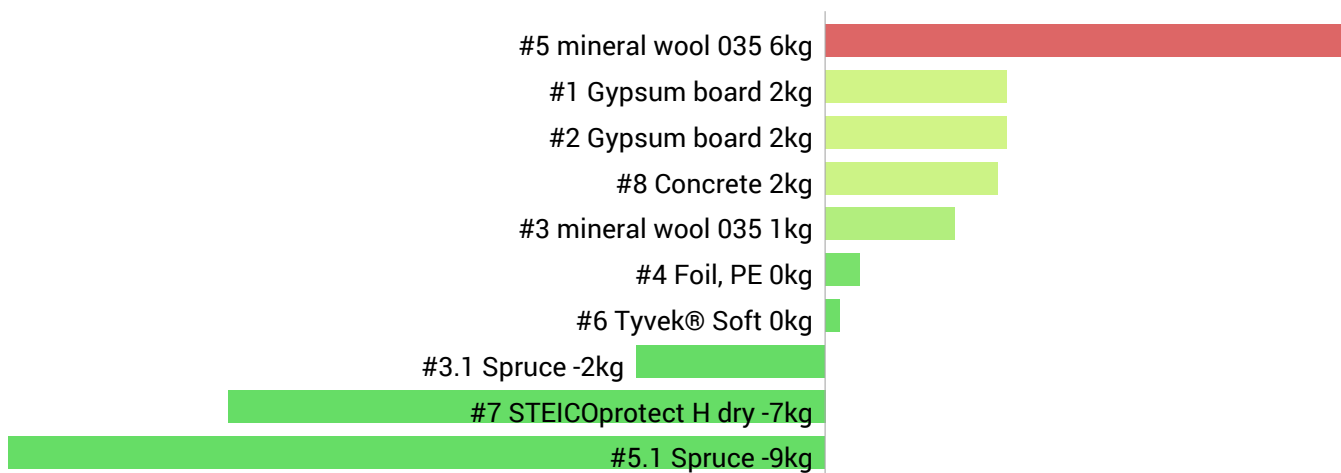


Global warming potential and primary energy for construction and use

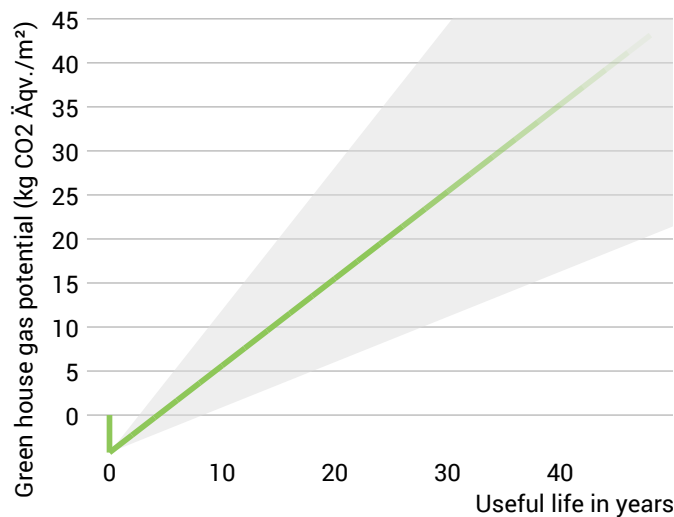

The **left figure** shows the global warming potential of the production of the component in the vertical part of the curve. Greenhouse gas emissions (through heating) arising during use of the building are indicated by the upward curve.

The **figure at the bottom left** shows the non-renewable primary energy expenditure for the production of the component in the vertical part of the curve. The primary energy required during use of the building (through heating) is represented by the upward curve.

The longer the component is used unchanged, the more environmentally friendly it is, because the production costs contribute less to the total emissions (indicated by the color of the curve).

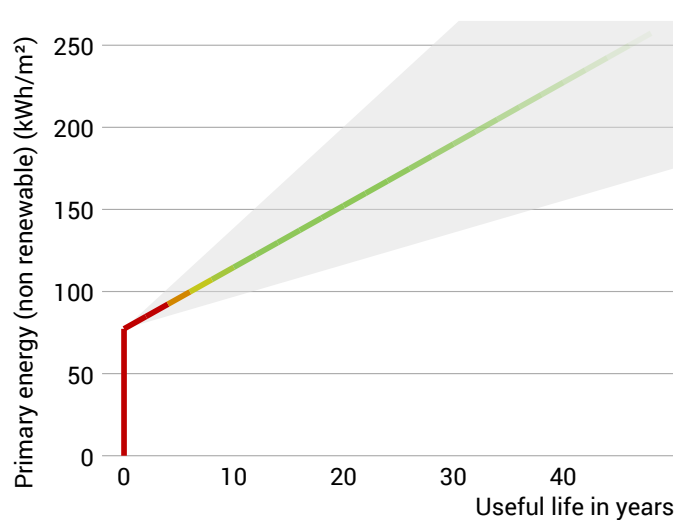



Due to unknown solar and internal gains, the heating demand can only be estimated. Accordingly, primary energy consumption and global warming potential during the use phase are only vaguely known. For the estimation it was assumed that solar and internal profits contribute with 4 kWh/a/m² component area. The light gray area indicates the area in which the curve is located with great certainty. For heat generation, a primary energy input of 0,60 kWh per kWh of heat and a global warming potential of 0,16 kg CO₂ eqv/m² per kWh of heat was used. Heat source: Heat pump (air-water).

Hints

Calculated for the location DIN V 18599, heating period from Mid of October to End of April. The calculation is based on monthly average temperatures. Source: DIN V 18599-10:2007-02

The climate and energy data on which this calculation is based can, in some cases, show considerable fluctuations and, in individual cases, deviate considerably from the actual value.

Temperature profile

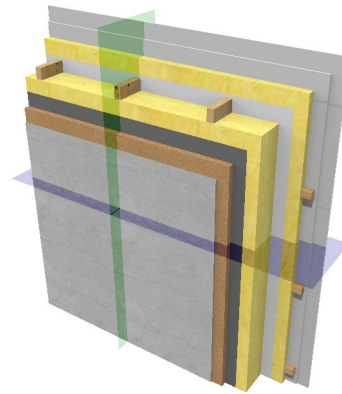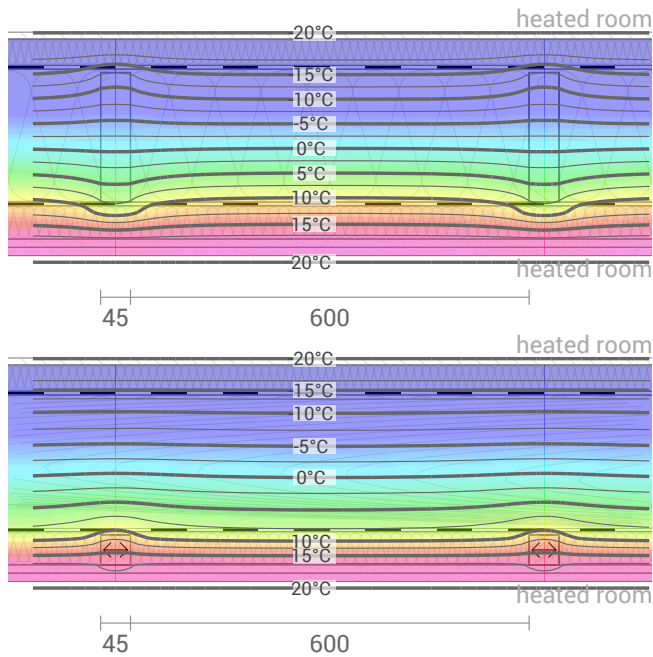

Top left: Temperature profile in the blue section (see right illustration). Bottom left: Temperature profile in the green section.

Layers (from inside to outside)

#	Material	λ [W/mK]	R [m²K/W]	Temperatur [°C]		Weight [kg/m²]
				min	max	
	Thermal contact resistance*		0,250	18,5	20,0	
1	1,25 cm Gypsum board	0,250	0,050	18,2	18,8	8,5
2	1,25 cm Gypsum board	0,250	0,050	17,9	18,6	8,5
3	5 cm mineral wool 035	0,035	1,429	7,6	18,3	0,9
	4,5 cm Spruce (Width: 4,5 cm)	0,130	0,346			1,4
4	0,02 cm Foil, PE	0,400	0,001	7,6	11,6	0,2
5	20 cm mineral wool 035	0,035	5,714	-15,4	11,6	3,7
	19,5 cm Spruce (Width: 4,5 cm)	0,130	1,500	-11,5	8,1	6,1
6	0,015 cm Tyvek® Soft	0,230	0,001	-15,4	-12,7	0,1
7	4 cm STEICOprotect H dry	0,043	0,930	-19,8	-12,7	7,2
8	1 cm Concrete	2,000	0,005	-19,8	-19,7	24,0
	Thermal contact resistance*		0,040	-20,0	-19,7	
	32,535 cm Whole component		7,596			60,6

*Thermal contact resistances according to DIN 4108-3 for moisture protection and temperature profile. The values for the U-value calculation can be found on the page 'U-value calculation'.



Surface temperature inside (min / average / max): 18,5°C 18,7°C 18,8°C
 Surface temperature outside (min / average / max): -19,8°C -19,8°C -19,7°C

Moisture protection in accordance with DIN 4108-3:2018 Appendix A

The temperatures and / or humidities you specify are not in accordance with DIN 4108-3. The following values are given by DIN 4108-3: 20°C / 50% humidity inside and -5°C / 80% humidity outside. Change the values in the input form to enable the calculation according to DIN 4108-3.

Heat protection

The following results are properties of the tested component alone and do not make any statement about the heat protection of the entire room:

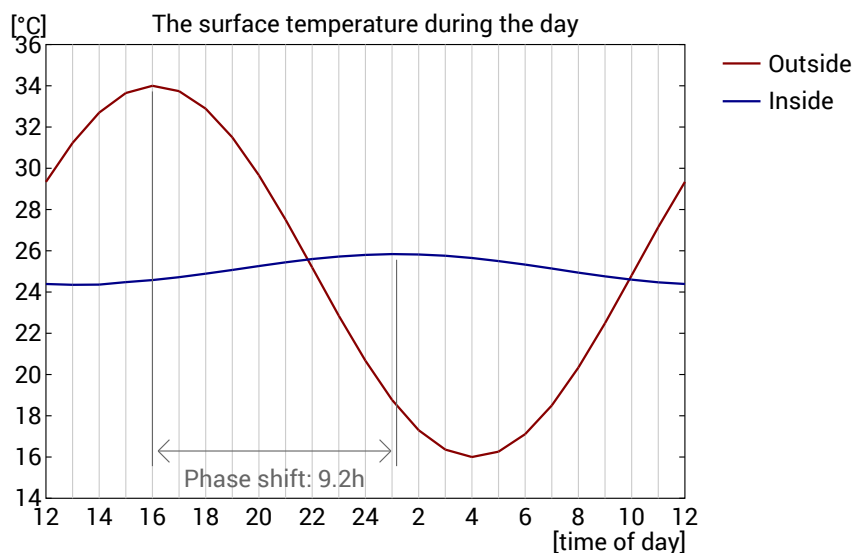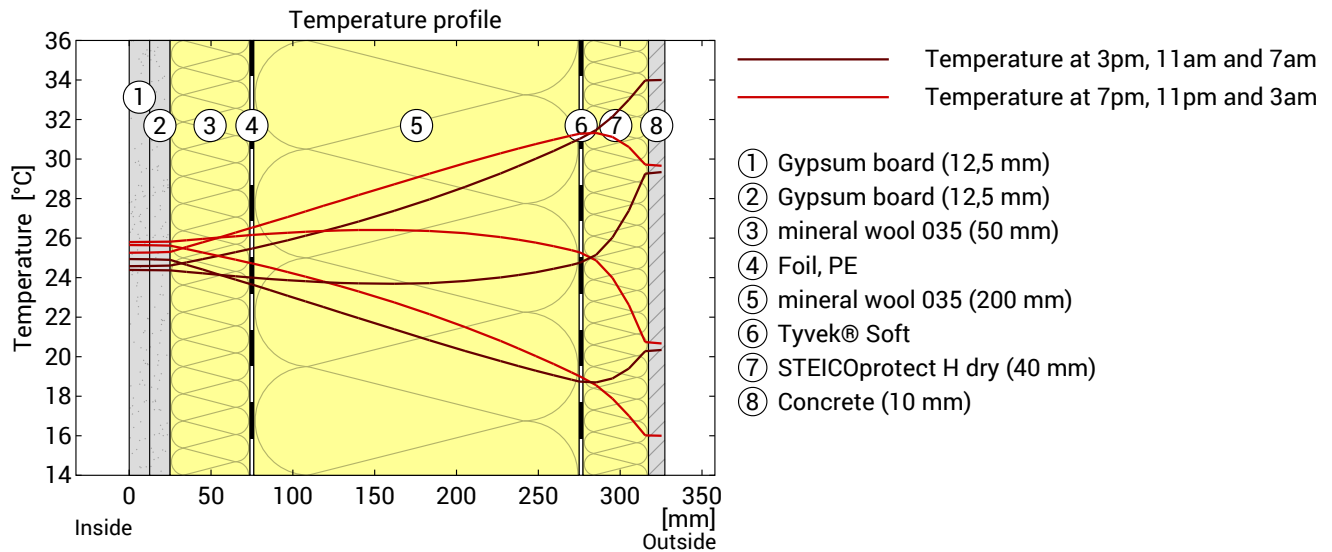

Top: Temperature profile within the component at different times. From top to bottom, brown lines: at 3 pm, 11 am and 7 am and red lines at 7 pm, 11 pm and 3 am.

Bottom: Temperature on the outer (red) and inner (blue) surface in the course of a day. The arrows indicate the location of the temperature maximum values . The maximum of the inner surface temperature should preferably occur during the second half of the night.

Phase shift*	9,2 h	Heat storage capacity (whole component):	68 kJ/m ² K
Amplitude attenuation **	12,1	Thermal capacity of inner layers:	24 kJ/m ² K
TAV ***	0,083		

* The phase shift is the time in hours after which the temperature peak of the afternoon reaches the component interior.

** The amplitude attenuation describes the attenuation of the temperature wave when passing through the component. A value of 10 means that the temperature on the outside varies 10x stronger than on the inside, e.g. outside 15-35 °C, inside 24-26 °C.

*** The temperature amplitude ratio TAV is the reciprocal of the attenuation: $TAV = 1 / \text{amplitude attenuation}$

Note: The heat protection of a room is influenced by several factors, but essentially by the direct solar radiation through windows and the total amount of heat storage capacity (including floor, interior walls and furniture). A single component usually has only a very small influence on the heat protection of the room.

The calculations presented above have been created for a 1-dimensional cross-section of the component.